


DRAWING NO. C-2
ENTRANCE STATION SITE

NOTE:


1. MINIMUM 200' RECOMMENDED FROM HIGHWAY INTERSECTION TO THE ENTRANCE STATION
2. SEE TABLE [3.1](#)

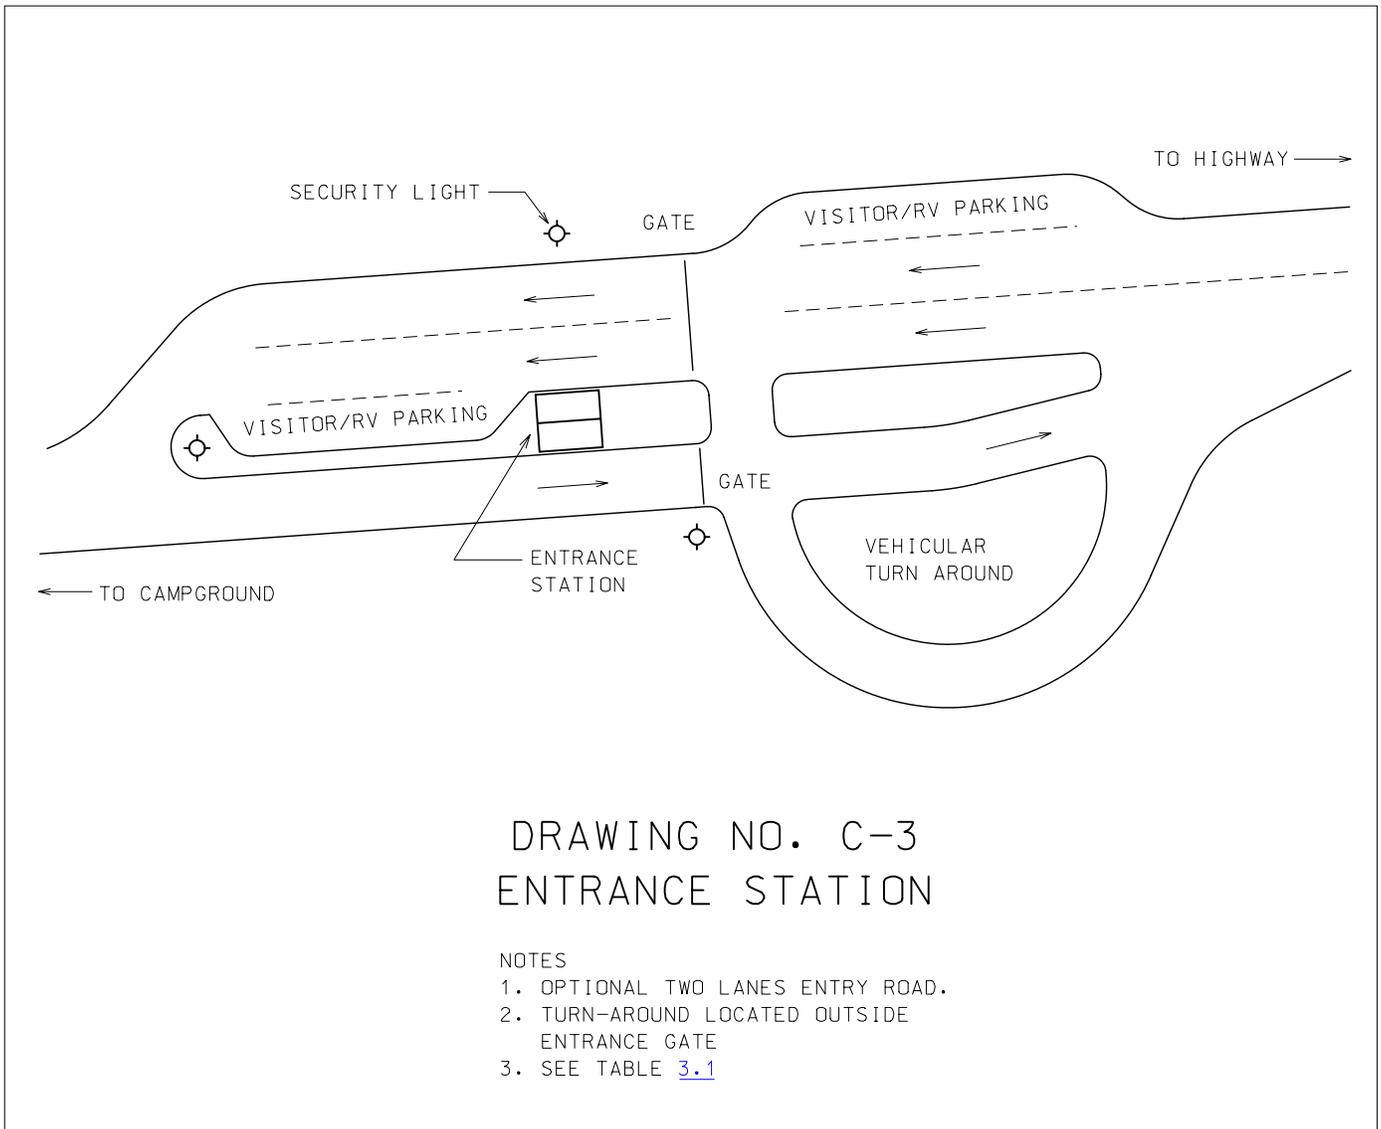

DRAWING NO. C-3
ENTRANCE STATION

NOTES



1. OPTIONAL TWO LANES ENTRY ROAD.
2. TURN-AROUND LOCATED OUTSIDE ENTRANCE GATE
3. SEE TABLE [3.1](#)

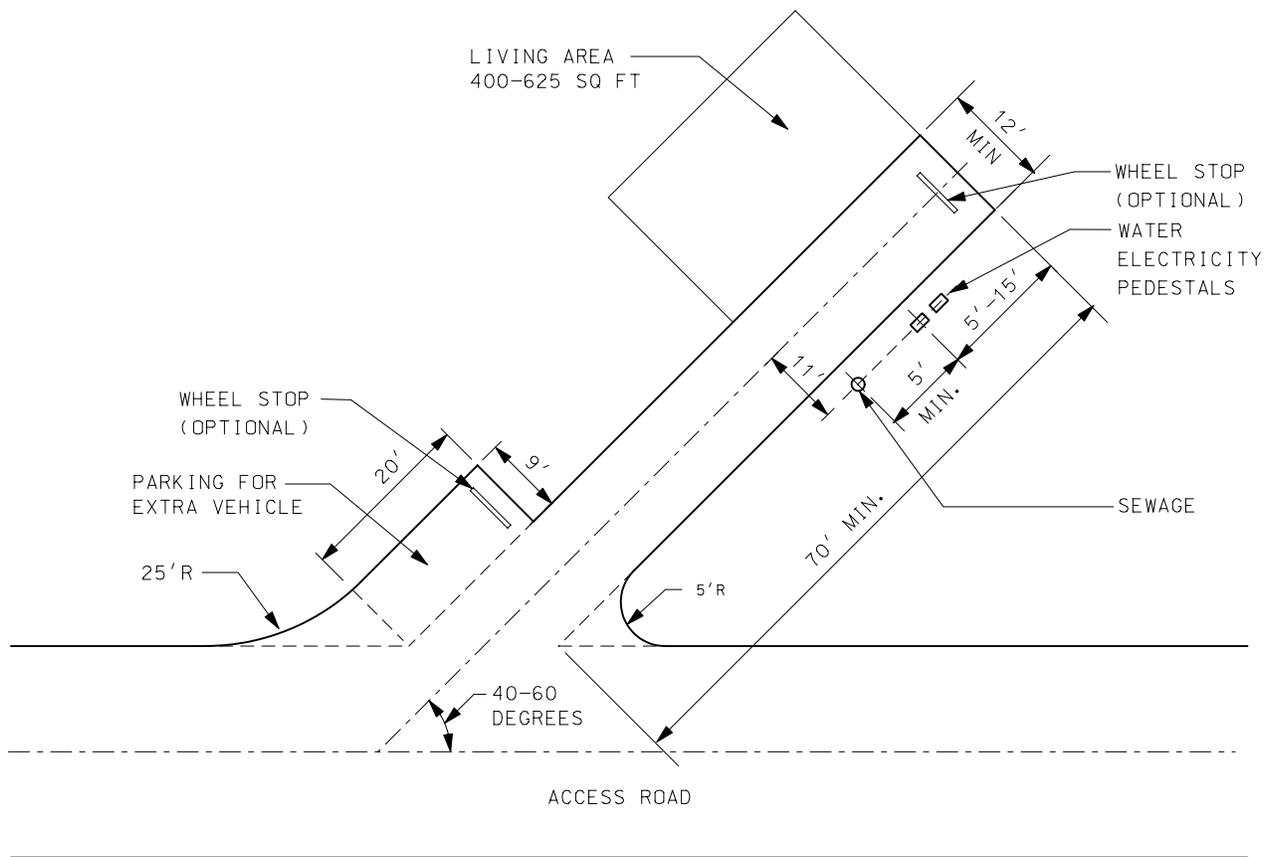

DRAWING NO. C-4 TYPICAL BACK-IN CAMPSITE




NOTES:

1. UTILITIES SHALL BE A MINIMUM OF 11' FROM THE CENTER OF THE PAD ON THE DRIVER'S SIDE.
2. WATER & ELECTRICITY SHALL NOT EXCEED 15' FROM END OF PAD
3. SEWAGE SHALL BE LOCATED MINIMUM 5' FORWARD OF UTILITY PEDESTALS.
4. SLIDE OUT CLEARANCE 20' MAXIMUM.
5. SEE TABLES [5.4](#), AND [5.5](#)

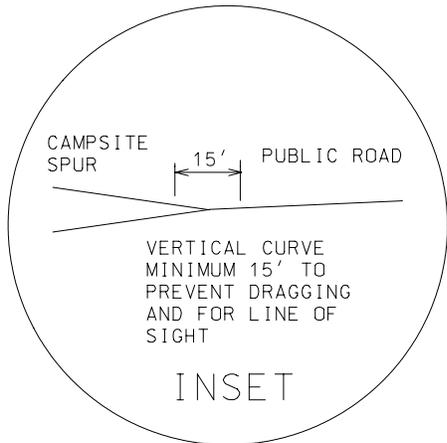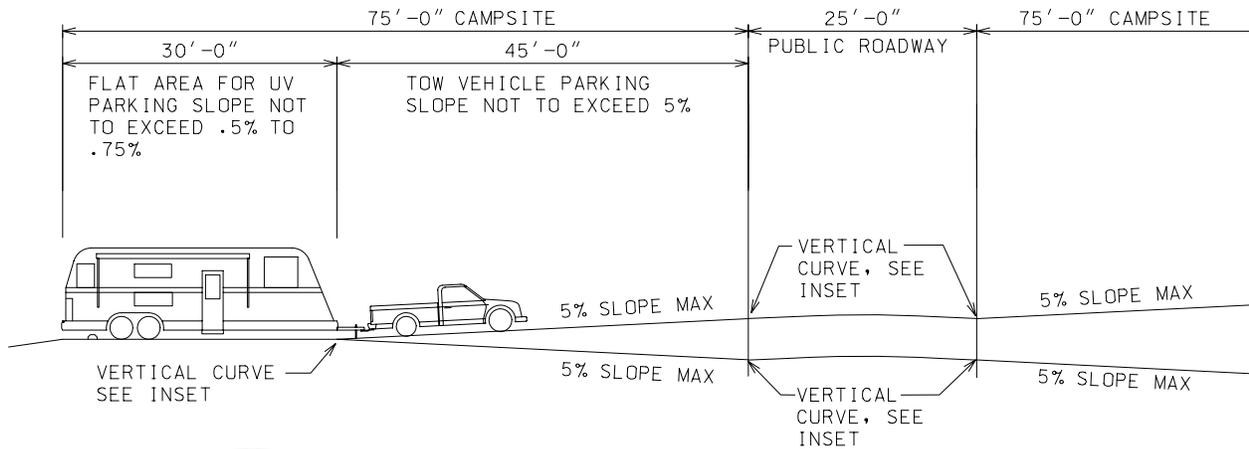


DRAWING NO. C-5
TYPICAL BACK-IN CAMPSITE SECTION

NOTE:
SEE TABLE [5.3](#)

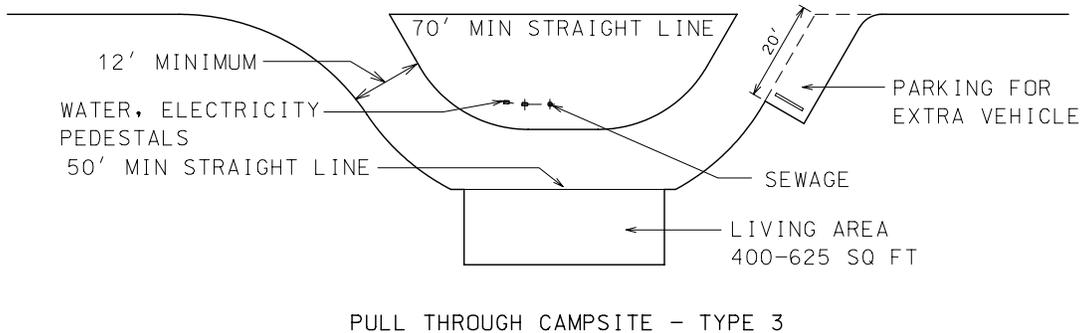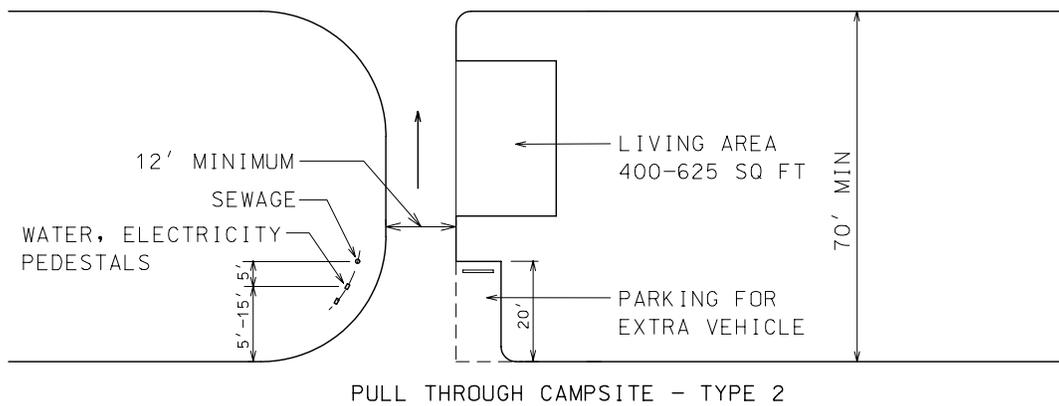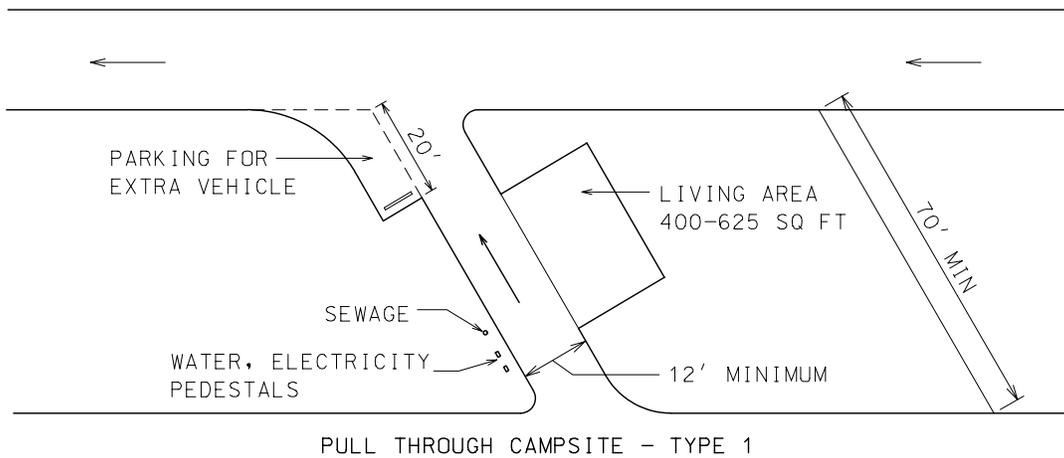

DRAWING NO. C-6
PULL-THROUGH CAMPSITE EXAMPLES


- NOTE:
1. USE SAME SPECIFICATIONS FOR UTILITIES AS TYPICAL BACK-IN CAMPSITES.
 2. SEE TABLES [4.4](#), [5.3](#), [5.4](#) AND [5.5](#)

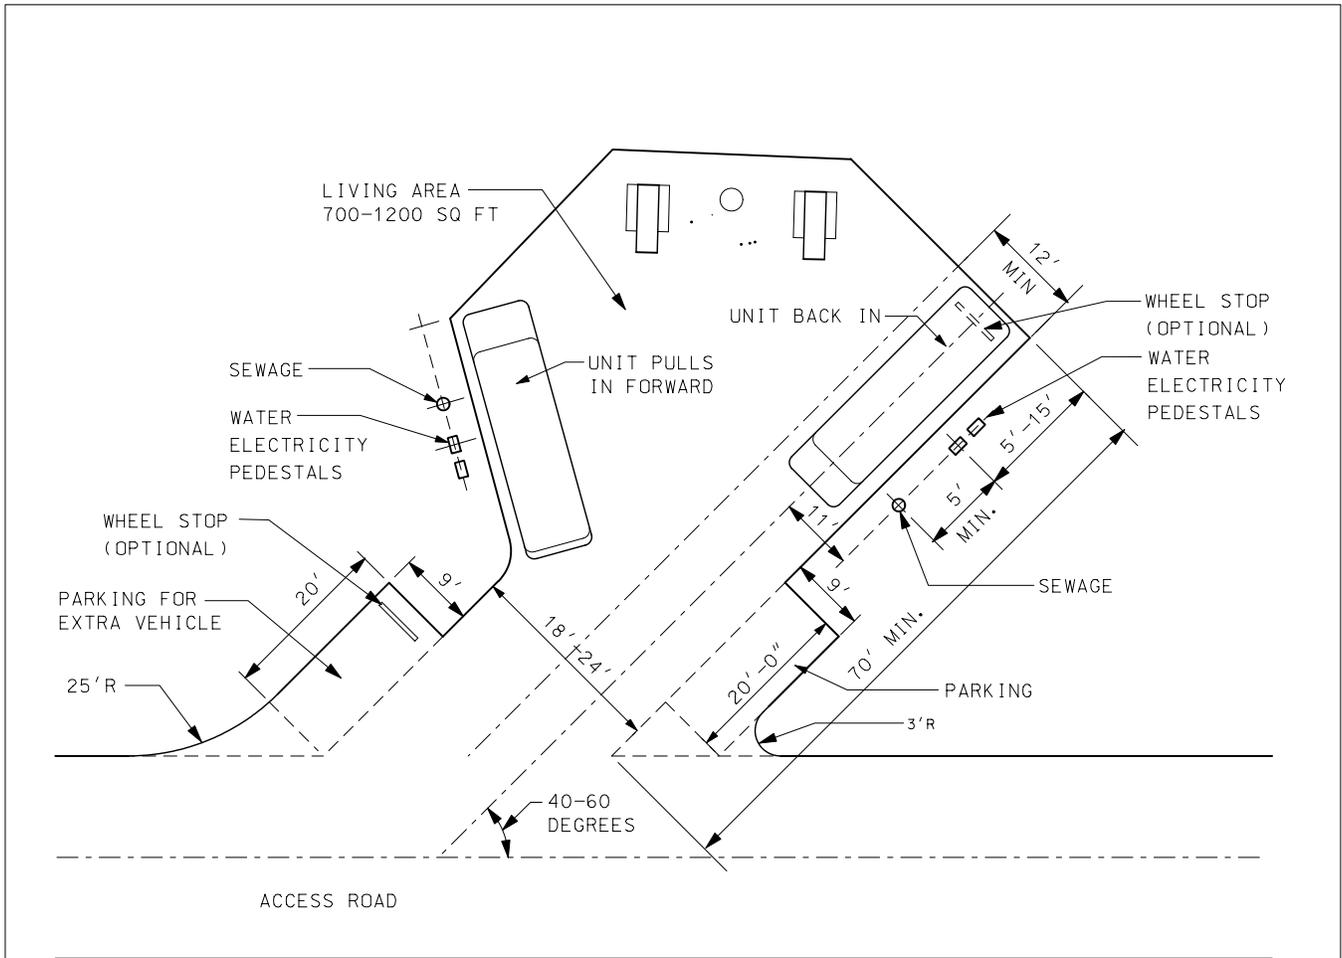

DRAWING NO. C-7
TYPICAL MULTI-UNIT CAMPSITE


NOTES:

1. UTILITIES SHALL BE A MINIMUM OF 11' FROM THE CENTER OF THE PAD ON THE DRIVER'S SIDE.
2. WATER & ELECTRICITY SHALL NOT EXCEED 15' FROM END OF PAD
3. SEWAGE SHALL BE LOCATED MINIMUM 5' FORWARD OF UTILITY PEDESTALS.
4. SLIDE OUT CLEARANCE 20' MAXIMUM.
5. SEE TABLES [5.4](#) AND [5.5](#)

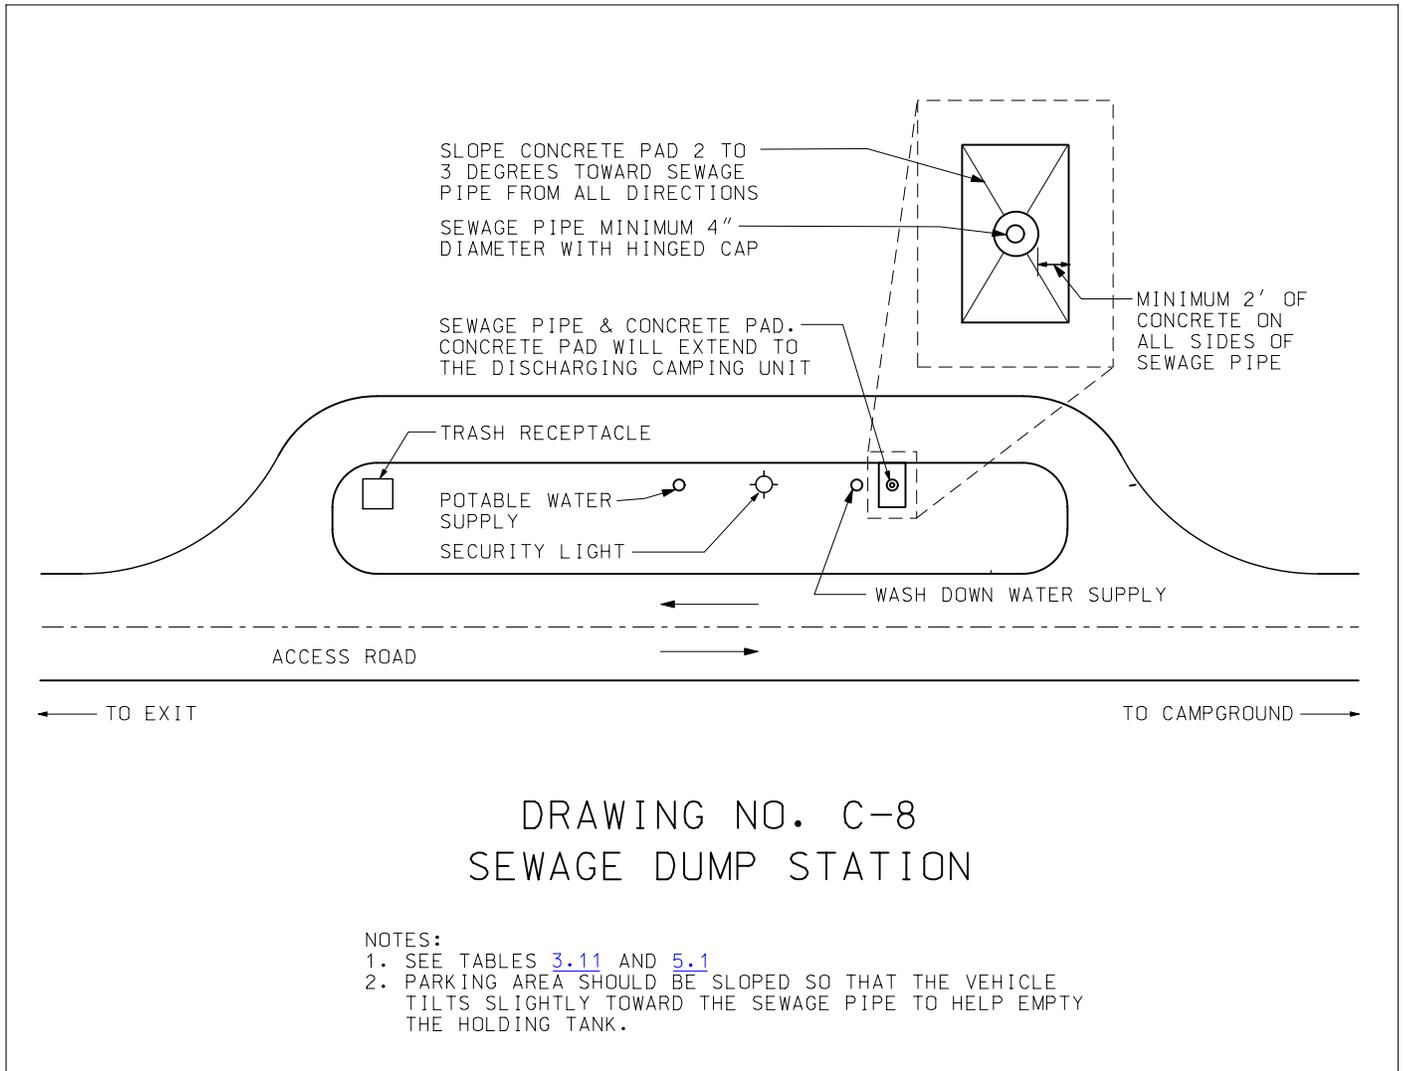

DRAWING NO. C-8
SEWAGE DUMP STATION


- NOTES:
1. SEE TABLES 3.11 AND 5.1
2. PARKING AREA SHOULD BE SLOPED SO THAT THE VEHICLE TILTS SLIGHTLY TOWARD THE SEWAGE PIPE TO HELP EMPTY THE HOLDING TANK.

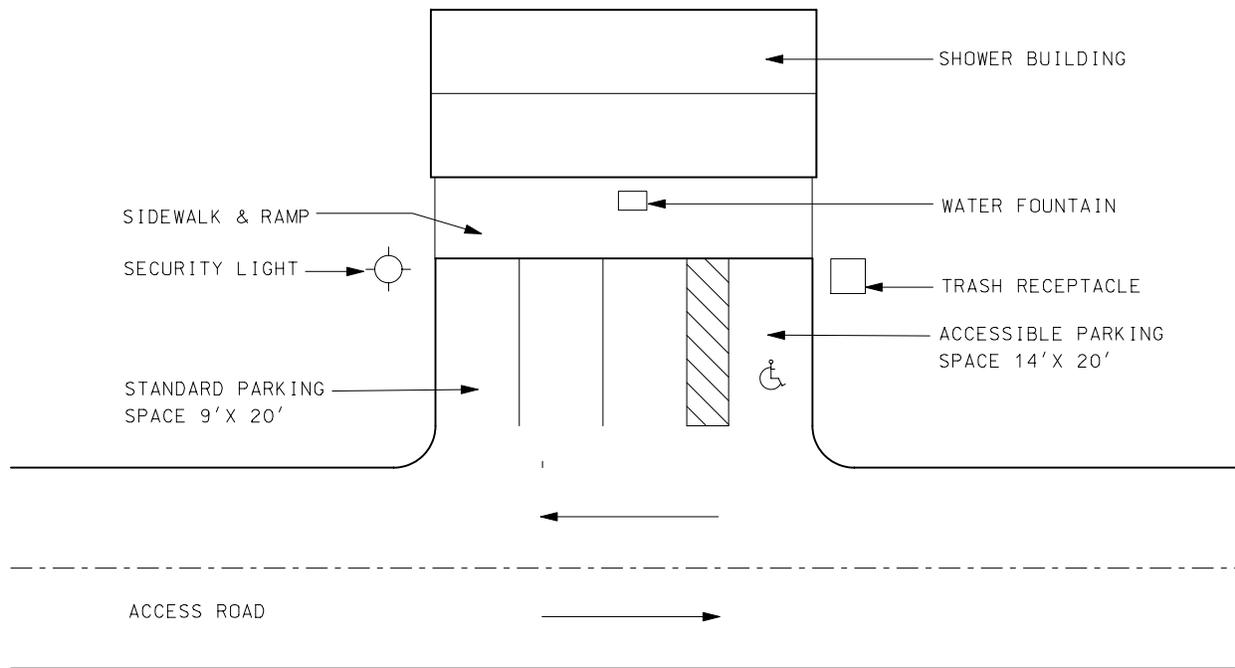

DRAWING NO. C-9
SHOWER FACILITY AND PARKING OVERVIEW

NOTES:

1. MINIMUM PARKING AREA SAME WIDTH AS BUILDING LENGTH.
2. STANDARD GRADE OF 1-5%.
3. SEE TABLE [3.3](#)

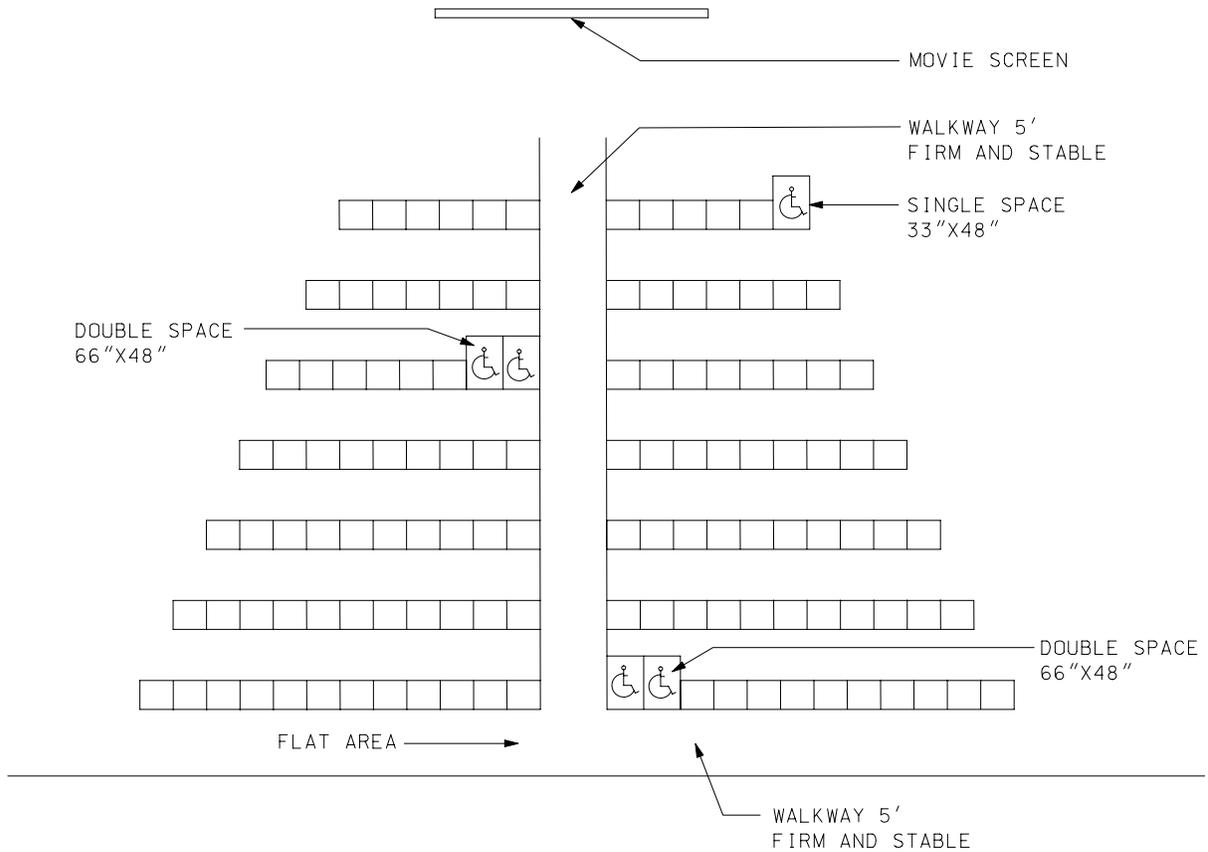

DRAWING NO. C-10 AMPHITHEATER

NOTES:

1. AMPHITHEATER SHOULD BE ORIENTED IN A NORTH-SOUTH DIRECTION.
2. AMPHITHEATER SLOPE SHOULD NOT EXCEED 30 DEGREES.
3. ELECTRICITY WITH GFCI SHOULD BE PROVIDED FOR SUPPORT EQUIPMENT.
4. MAIN PATHWAYS SHOULD BE LIGHTED WITH ADJUSTABLE ILLUMINATION LEVELS.
5. CONSULT UA GUIDELINE FOR SPECIFIC ACCESSIBILITY STANDARDS.
6. SEE TABLE [5.17](#)